

**Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 02 February 2026**

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	17:11	Middle	<0.5	18.8	18.8	7.7	7.7	0.10	0.10	87.8	87.7	8.2	8.2	19.9	19.9	1.0	1.0
					18.8		7.7		0.10		87.6		8.2		19.9		1.0	
M1	Sunny	16:41	Middle	<0.5	18.5	18.5	8.2	8.2	0.11	0.11	75.4	74.7	7.1	7.0	18.4	18.1	1.0	1.0
					18.5		8.2		0.11		74.0		6.9		17.7		1.0	

Remark: If the lab result of SS concentration at control station was less than 1.0 mg/L, 1.0 mg/L would be assumed as the SS concentration for calculating the action and limit levels based on the control station as a conservative approach.

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 04 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:47	Middle	<0.5	21.0	21.0	7.9	7.9	0.10	0.10	74.0	74.0	6.6	6.6	22.2	22.0	2.7	1.9
					21.0		7.9		0.10		74.0		6.6		21.7		1.1	
M1	Sunny	16:16	Middle	<0.5	19.1	19.1	8.8	8.8	0.11	0.11	69.1	68.3	6.4	6.3	16.6	16.5	1.0	1.0
					19.1		8.8		0.11		67.4		6.2		16.4		1.0	

Remark: If the lab result of SS concentration at control station was less than 1.0 mg/L, 1.0 mg/L would be assumed as the SS concentration for calculating the action and limit levels based on the control station as a conservative approach.

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results or 06 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:54	Middle	<0.5	22.9	22.9	8.2	8.2	0.10	0.10	81.4	79.9	7.0	6.9	17.4	17.5	1.4	1.3
					22.9		8.2		0.10		78.4		6.7		17.5		1.2	
M1	Sunny	16:31	Middle	<0.5	20.8	20.5	8.7	8.7	0.11	0.11	70.1	67.2	6.3	6.0	19.8	19.8	1.8	1.8
					20.3		8.7		0.11		64.2		5.8		19.8		1.8	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 09 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:09	Middle	<0.5	17.2	17.2	7.8	7.8	0.10	0.10	72.5	72.3	7.0	7.0	18.2	18.6	4.3	2.8
					17.2		7.8		0.10		72.1		6.9		19.0		1.2	
M1	Sunny	15:25	Middle	<0.5	17.0	17.0	7.9	7.9	0.11	0.11	76.6	76.3	7.4	7.4	18.3	18.3	1.2	2.9
					17.0		7.9		0.11		75.9		7.3		18.3		4.5	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 11 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	15:40	Middle	<0.5	22.1	22.1	7.9	7.9	0.10	0.10	81.6	81.5	7.1	7.1	17.7	17.6	2.5	2.1
					22.1		7.9		0.10		81.3		7.1		17.5		1.6	
M1	Sunny	14:59	Middle	<0.5	20.1	20.1	8.1	8.1	0.11	0.11	75.4	75.0	6.8	6.8	20.2	20.1	4.5	4.3
					20.0		8.2		0.11		74.6		6.8		20.0		4.1	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 13 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:10	Middle	<0.5	22.2	22.0	8.0	7.8	0.10	0.10	77.3	79.3	6.7	6.9	6.0	6.3	1.0	1.6
					21.9		7.7		0.10		81.2		7.1		6.5		2.1	
M1	Sunny	15:39	Middle	<0.5	19.6	19.6	8.5	8.5	0.11	0.11	73.2	73.1	6.7	6.7	7.0	6.1	3.9	9.3
					19.5		8.5		0.11		73.0		6.7		5.3		14.7	

Remark: If the lab result of SS concentration at control station was less than 1.0 mg/L, 1.0 mg/L would be assumed as the SS concentration for calculating the action and limit levels based on the control station as a conservative approach.

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 16 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:20	Middle	<0.5	24.1	24.1	8.4	8.2	0.10	0.10	81.0	75.7	6.8	6.4	5.0	5.0	5.6	3.9
					24.1		7.9		0.10		70.3		5.9		4.9		2.2	
M1	Sunny	15:53	Middle	<0.5	22.2	22.2	8.5	8.5	0.11	0.11	69.4	69.3	6.0	6.0	5.0	5.0	7.5	5.1
					22.1		8.4		0.11		69.1		6.0		5.0		2.7	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 20 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	15:59	Middle	<0.5	22.7	22.7	8.3	8.3	0.09	0.09	83.4	83.0	7.2	7.2	6.5	6.3	4.4	4.5
					22.7		8.2		0.09		82.6		7.1		6.1		4.5	
M1	Sunny	15:36	Middle	<0.5	20.6	20.6	8.6	8.6	0.10	0.11	76.0	75.9	6.8	6.8	4.5	4.7	2.1	2.4
					20.5		8.6		0.11		75.7		6.8		4.9		2.6	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 23 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	15:56	Middle	<0.5	23.2	23.2	8.1	8.0	0.09	0.09	87.2	84.6	7.5	7.2	4.8	4.7	2.2	1.7
					23.2		8.0		0.09		81.9		7.0		4.6		1.2	
M1	Sunny	15:27	Middle	<0.5	21.2	21.2	8.0	8.0	0.10	0.10	72.8	72.8	6.5	6.4	5.0	5.0	2.2	1.9
					21.3		8.0		0.10		72.7		6.4		5.0		1.6	


Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 25 February 2026

Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	15:22	Middle	<0.5	22.6	22.6	7.8	7.8	0.10	0.10	65.2	65.1	5.6	5.6	5.8	5.9	3.0	3.0
					22.6		7.8		0.10		64.9		5.6		6.1		2.9	
M1	Sunny	14:52	Middle	<0.5	22.0	22.0	7.8	7.8	0.12	0.12	63.9	63.6	5.6	5.6	10.7	10.6	4.6	3.6
					22.0		7.8		0.12		63.2		5.5		10.5		2.6	

Contract No. HATS 01/2025 Environmental Team for Hung Shui Kiu Effluent Polishing Plant Phase 1
Water Quality Monitoring Results on 27 February 2026


Location	Weather Condition	Sampling Time	Depth (M)		Temperature (°C)		pH		Salinity ppt		DO Saturation (%)		Dissolved Oxygen (mg/L)		Turbidity(NTU)		Suspended Solids (mg/L)	
					Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average	Value	Average
C1	Sunny	16:13	Middle	<0.5	22.9	22.9	8.1	8.1	0.11	0.11	75.5	72.8	6.5	6.3	10.5	10.4	12.1	12.0
					22.9		8.1		0.11		70.0		6.0		10.3		11.9	
M1	Sunny	16:36	Middle	<0.5	22.4	22.4	8.1	8.1	0.12	0.12	82.2	78.7	7.1	6.8	4.8	5.1	1.0	1.0
					22.4		8.1		0.12		75.2		6.5		5.3		1.0	


Remark: If the lab result of SS concentration at control station was less than 1.0 mg/L, 1.0 mg/L would be assumed as the SS concentration for calculating the action and limit levels based on the control station as a conservative approach.

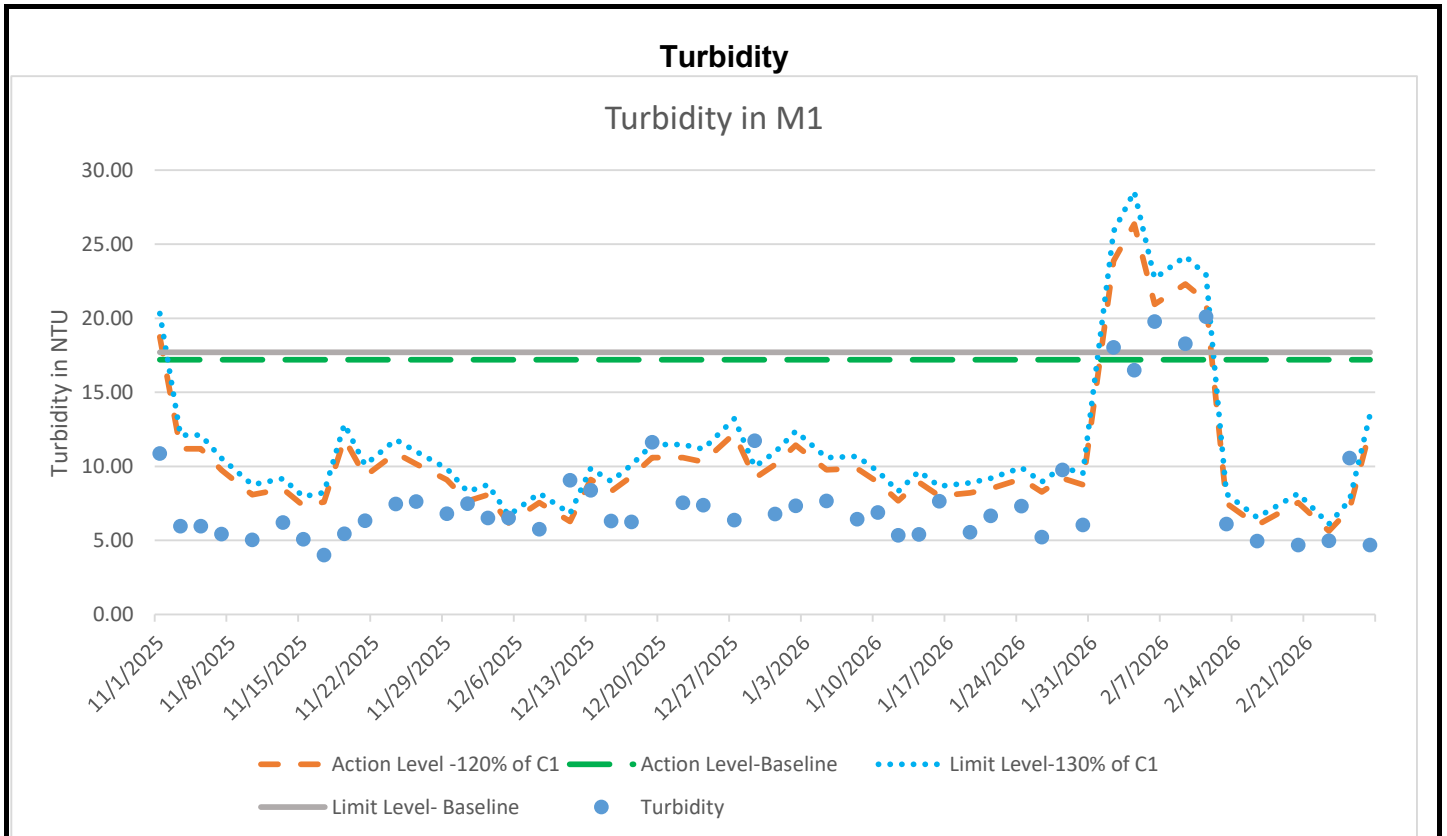


<p style="margin: 0;">Title</p> <p style="text-align: center; margin: 5px 0;">Contract No. HATS 01/2025 ET for Hung Shui Kiu Effluent Polishing Plant Phase 1</p> <p style="text-align: center; margin: 10px 0;">Graphical Presentation of Impact Water Quality Monitoring Results</p>	Scale	N.T.S	Project No.	MA25111	CINOTECH
	Date	Feb-26	Appendix	E	

Dissolved Oxygen

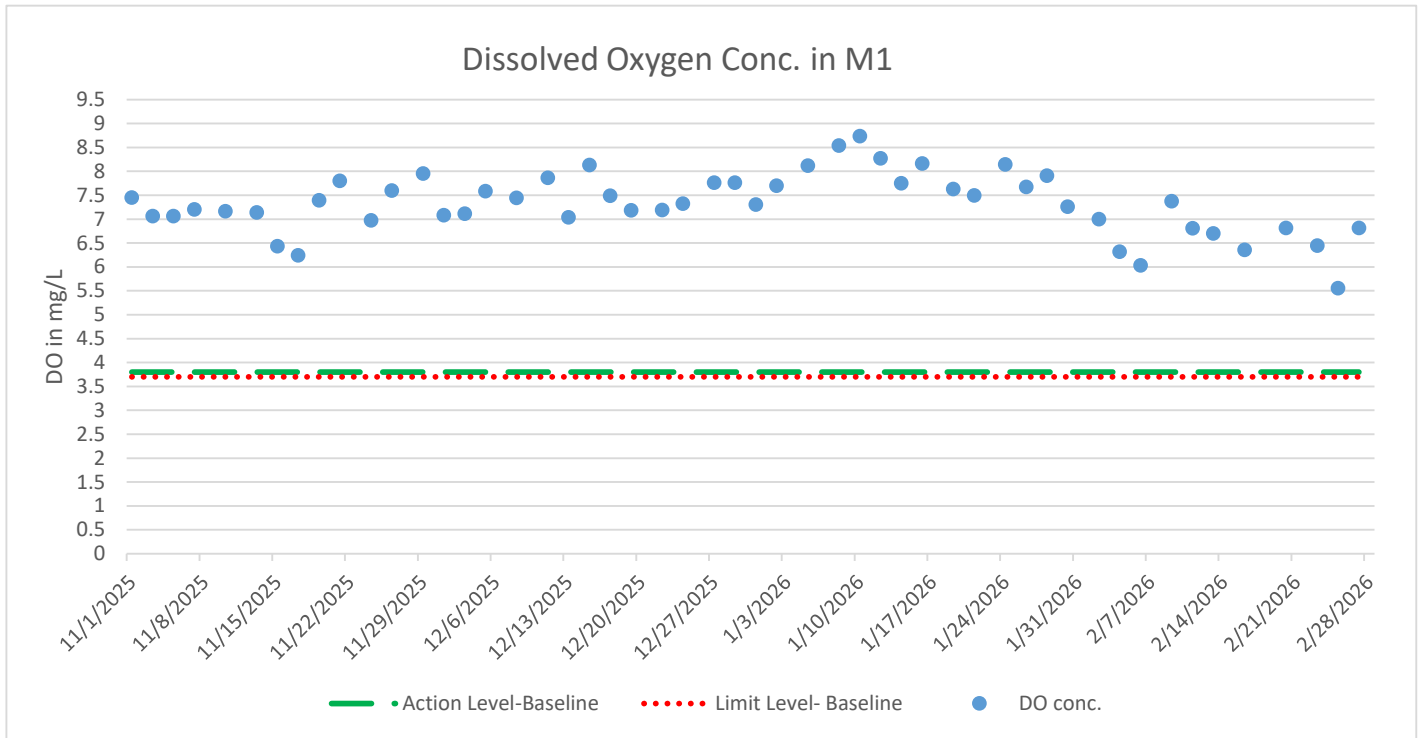

Title Contract No. HATS 01/2025 ET for Hung Shui Kiu Effluent Polishing Plant Phase 1 Graphical Presentation of Impact Water Quality Monitoring Results	Scale N.T.S	Project No. MA25111	
	Date Feb-26	Appendix E	

Suspended Solids

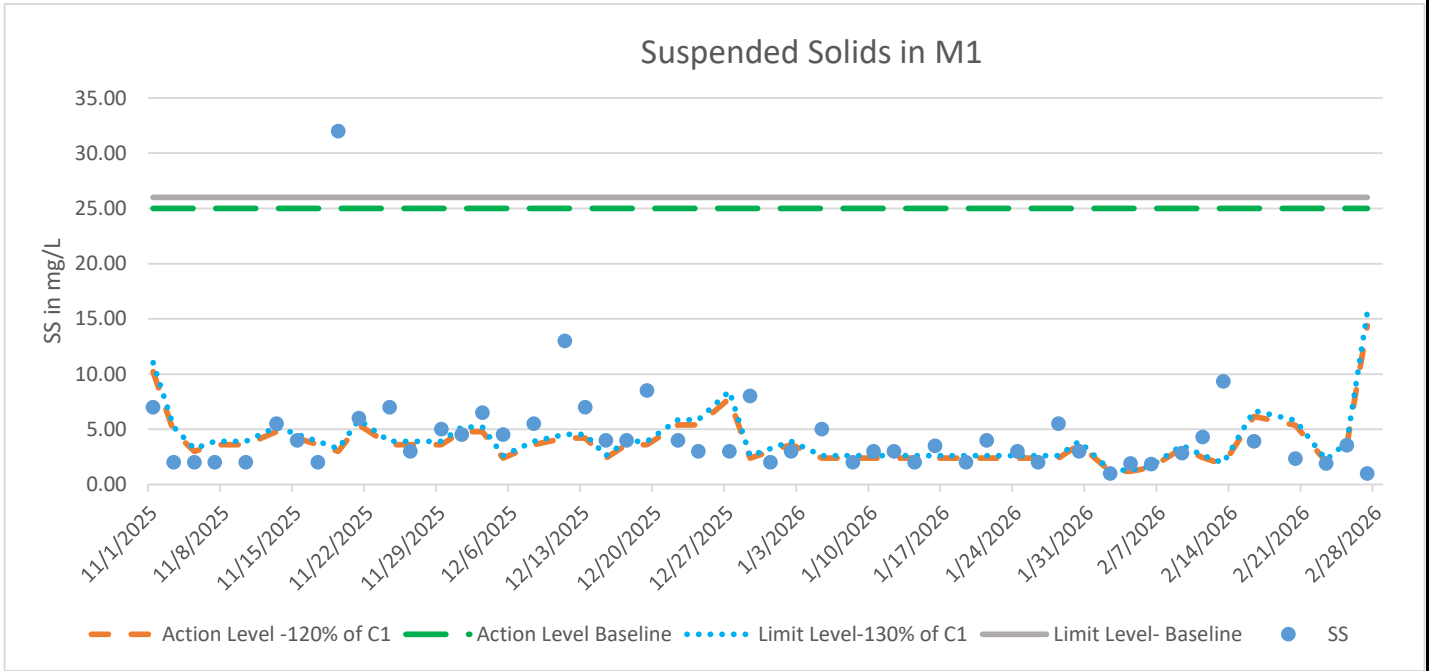

Title Contract No. HATS 01/2025 ET for Hung Shui Kiu Effluent Polishing Plant Phase 1 Graphical Presentation of Impact Water Quality Monitoring Results	Scale N.T.S	Project No. MA25111	
	Date Feb-26	Appendix E	